


MiTek USA, Inc.



SIMPSON DTT1Z (OR EQUIVALENT) ATTACHED PER HANGER MANUFACTURERS INSTALLATION PROCEDURE TO MEET DECK TENSION DEVICE REQUIREMENTS OF THE INTERNATIONAL RESIDENTIAL CODE.

MIN 1.5X4 CONNECTOR PLATES AT THESE JOINTS  
PLATE ON RIBBON BLOCK MAY BE OMITTED IF A 16" LONG 3/4" PLYWOOD OR OSB GUSSET (23/32" RATED SHEATHING 48/24 EXP 1) FULL DEPTH IS APPLIED TO EACH FACE OF TRUSS WITH CONSTRUCTION QUALITY ADHESIVE AND ONE ROW OF (0.131" X 2.5") NAILS SPACED 2" O.C. FROM EACH FACE. FACE GRAIN HORZ. USE 2" MEMBER END DISTANCE.

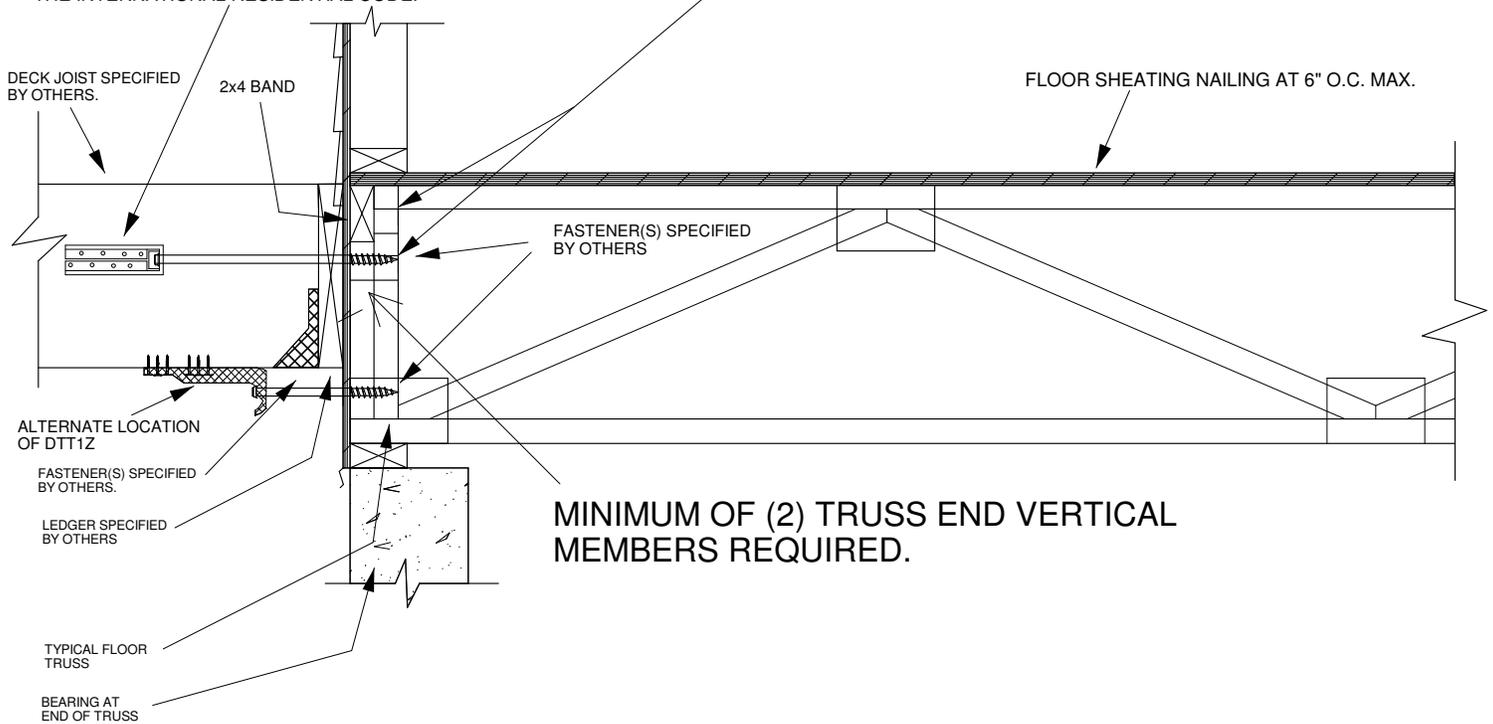

**MINIMUM OF (2) TRUSS END VERTICAL MEMBERS REQUIRED.**

**NOTES:**

FASTENERS SHALL NOT INTERFERE WITH ANY JOINTS OR CONNECTORS WITHIN THE FLOOR OR LADDER TRUSS AND BE INSTALLED PER NDS.

CAPACITY OF CONNECTION SHALL BE SPECIFIED BY THE BUILDING DESIGNER. REFER TO NATIONAL, STATE, LOCAL BUILDING CODES OR STANDARD INDUSTRY DETAILS APPROVED BY THE BUILDING OFFICAL.

END DIAGONAL WEB MUST GO TO BEARING JOINT AS SHOWN.

DESIGN OF ALL DECK OR PORCH COMPONENTS SHALL BE BY OTHERS.