


MiTek USA, Inc.






LOADING (PSF)

TCLL	30.0
TCDL	10.0
BCLL	0.0
BCDL	10.0

LEDGER CAPACITY BASED ON SPF LUMBER

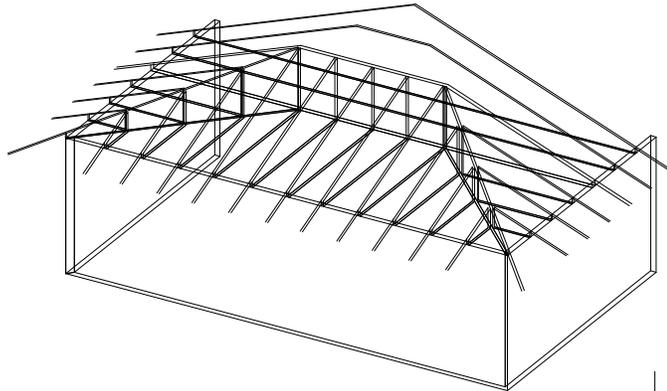

NOTE: MAXIMUM 1/4" GAP ALLOWED BETWEEN END VERTICAL AND GIRDER TRUSS

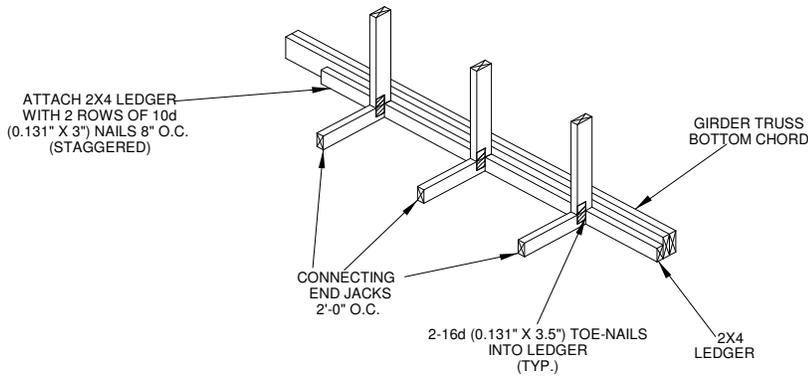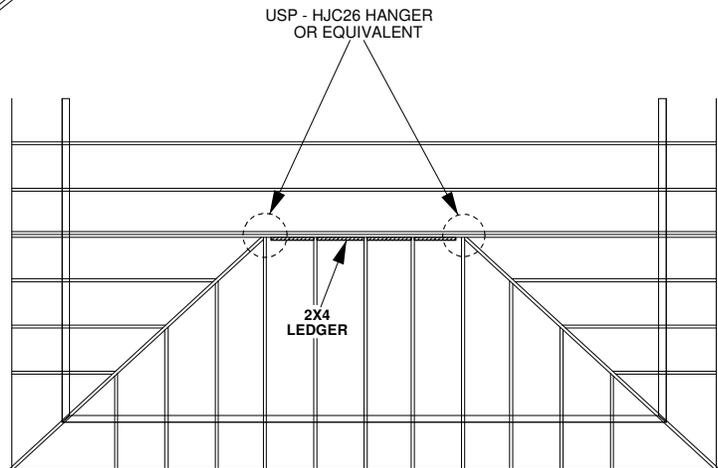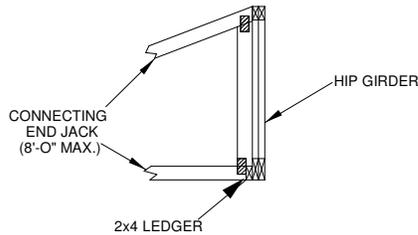

MAX MEAN ROOF HEIGHT = 30 FEET
 CATEGORY II BUILDING
 EXPOSURE B or C
 ASCE 7-98, ASCE 7-02, ASCE 7-05 120 MPH
 ASCE 7-10, ASCE 7-16 150 MPH
 WIND DURATION OF LOAD INCREASE : 1.60
 MAX TRUSS SPACING = 24" O.C.
 MAX STUD SPACING = 24" O.C.
 MINIMUM PITCH 3/12
 MAXIMUM PITCH 12/12