


2 x UPLIFT LEDGER. SECURE TO GIRDER TRUSS WITH CONSTRUCTION QUALITY ADHESIVE AND 10d (0.131" X 3") NAILS AS FOLLOWS:

SINGLE TOP CHORD - 1 ROW @ 3" O.C.

DOUBLE TOP CHORD - 2 ROWS @ 3" O.C.
(1 ROW IN EACH CHORD MEMBER)

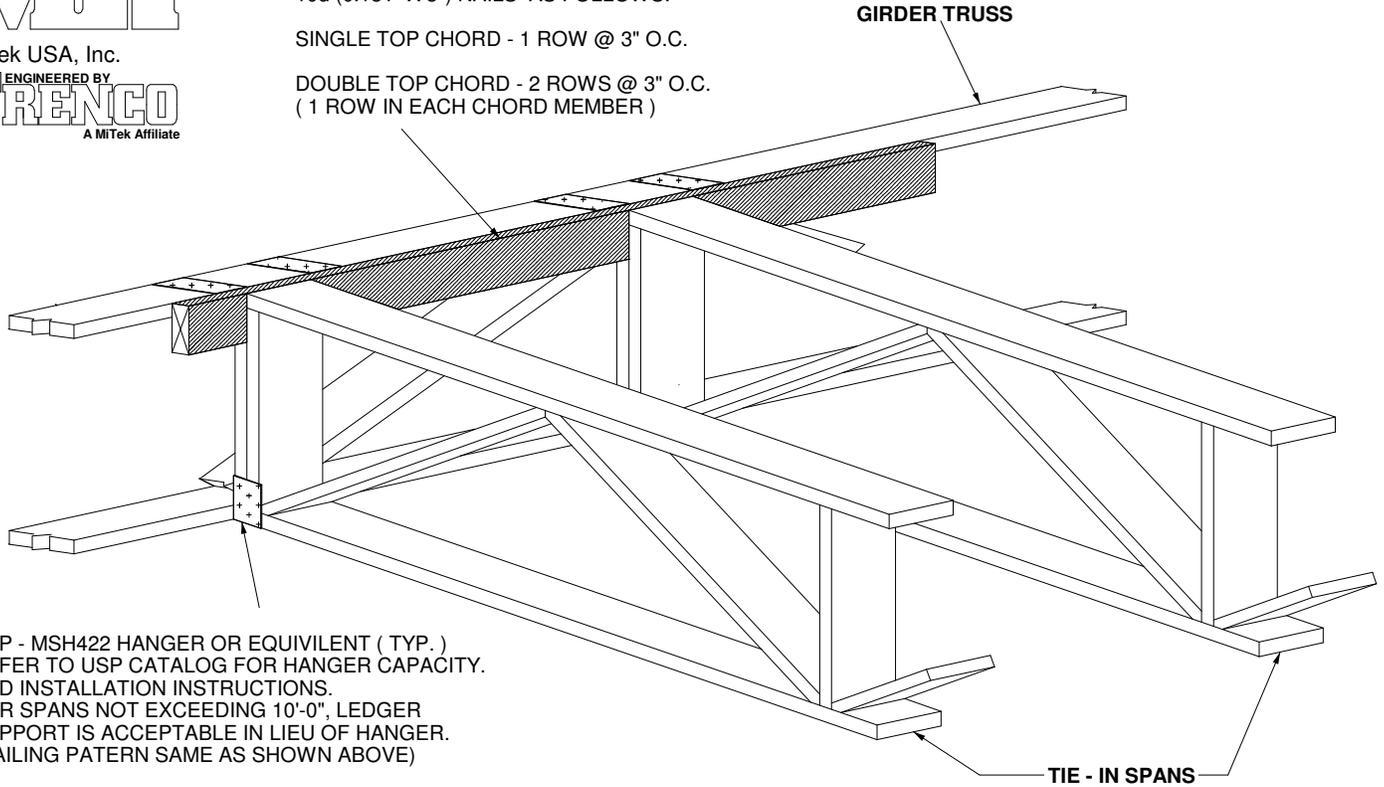

USP - MSH422 HANGER OR EQUIVLENT (TYP.) REFER TO USP CATALOG FOR HANGER CAPACITY. AND INSTALLATION INSTRUCTIONS. FOR SPANS NOT EXCEEDING 10'-0", LEDGER SUPPORT IS ACCEPTABLE IN LIEU OF HANGER. (NAILING PATERN SAME AS SHOWN ABOVE)

	MAX. LOAD APPLIED TO LEDGER (PLF)		
	SP	DOUG-FIR	SPF/HF
SINGLE TOP CHORD	404	372	316
DOUBLE TOP CHORD	808	744	632

NOTE: VALUES BASED ON FOLLOWING VALUES
 SP = 101#/nail
 DF = 93#/nail
 SPF = 79#/nail