


1. THIS IS A SPECIFIC REPAIR DETAIL TO BE USED ONLY FOR ITS ORIGINAL INTENTION. THIS REPAIR DOES NOT IMPLY THAT THE REMAINING PORTION OF THE TRUSS IS UNDAMAGED. THE ENTIRE TRUSS SHALL BE INSPECTED TO VERIFY THAT NO FURTHER REPAIRS ARE REQUIRED. WHEN THE REQUIRED REPAIRS ARE PROPERLY APPLIED, THE TRUSS WILL BE CAPABLE OF SUPPORTING THE LOADS INDICATED.
2. ALL MEMBERS MUST BE RETURNED TO THEIR ORIGINAL POSITIONS BEFORE APPLYING REPAIR AND HELD IN PLACE DURING APPLICATION OF REPAIR.
3. THE END DISTANCE, EDGE DISTANCE, AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID SPLITTING OF THE WOOD.
4. WHEN NAILING SCABS OR GUSSETS, THE USE OF A BACKUP WEIGHT IS RECOMMENDED TO AVOID LOOSENING OF THE CONNECTOR PLATES AT THE JOINTS OR SPLICES.
5. THIS REPAIR IS TO BE USED FOR SINGLE PLY TRUSSES IN THE 2X\_ ORIENTATION ONLY.

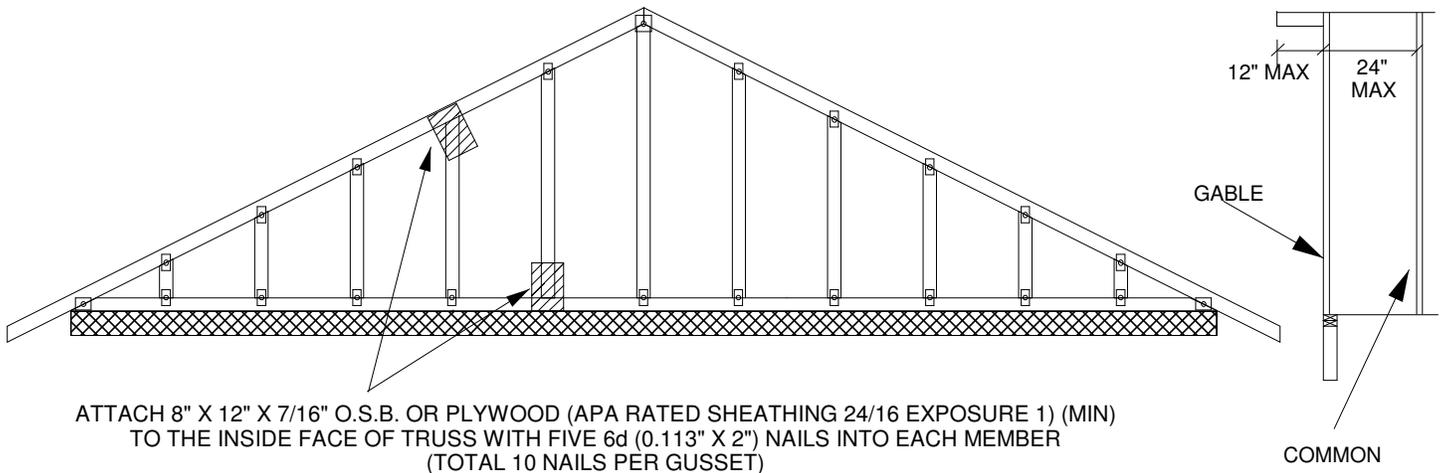

ATTACH 8" X 12" X 7/16" O.S.B. OR PLYWOOD (APA RATED SHEATHING 24/16 EXPOSURE 1) (MIN)  
TO THE INSIDE FACE OF TRUSS WITH FIVE 6d (0.113" X 2") NAILS INTO EACH MEMBER  
(TOTAL 10 NAILS PER GUSSET)

THE OUTSIDE FACE OF THE GABLE MUST BE SHEATHED WITH (MIN) 7/16" O.S.B OR PLYWOOD.  
SEE MITEK STANDARD GABLE END DETAILS FOR WIND BRACING REQUIREMENTS.

### TRUSS CRITERIA

LOADING : 40-10-0-10 (MAX)  
LOAD DURATION FACTOR : 1.15  
SPACING : 24" O.C. (MAX)  
TOP CHORD : 2X 4 OR 2X 6 (NO 2 MIN)  
PITCH : 3/12 - 12/12  
BEARING : CONTINUOUS  
STUD SPACING : 24" O.C. (MAX)

REFER TO INDIVIDUAL TRUSS DESIGN  
FOR PLATE SIZES AND LUMBER GRADES