



MiTek USA, Inc.

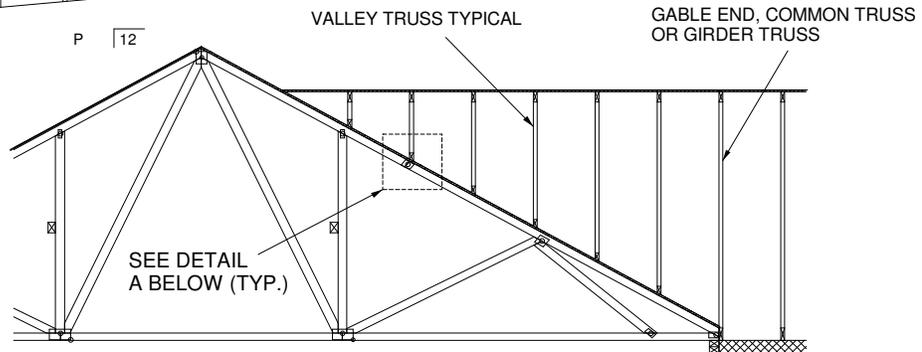


GENERAL SPECIFICATIONS

1. NAIL SIZE 16d (0.131" X 3.5")
2. INSTALL VALLEY TRUSSES (24" O.C. MAXIMUM) AND SECURE PER DETAIL A
3. BRACE VALLEY WEBS IN ACCORDANCE WITH THE INDIVIDUAL DESIGN DRAWINGS.
4. BASE TRUSS SHALL BE DESIGNED WITH A PURLIN SPACING EQUIVANT TO THE RAKE DIMENSION OF THE VALLEY TRUSS SPACING.
5. NAILING DONE PER NDS - 01
6. VALLEY STUD SPACING NOT TO EXCEED 48" O.C.
7. ALL LUMBER SPECIES TO BE SP.

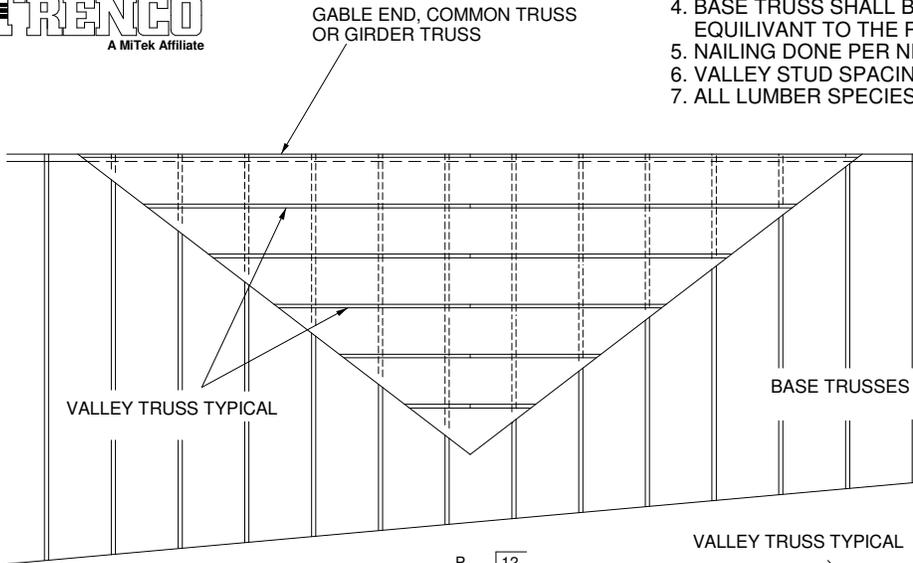

SECURE VALLEY TRUSS W/ ONE ROW OF 16d NAILS 6" O.C.

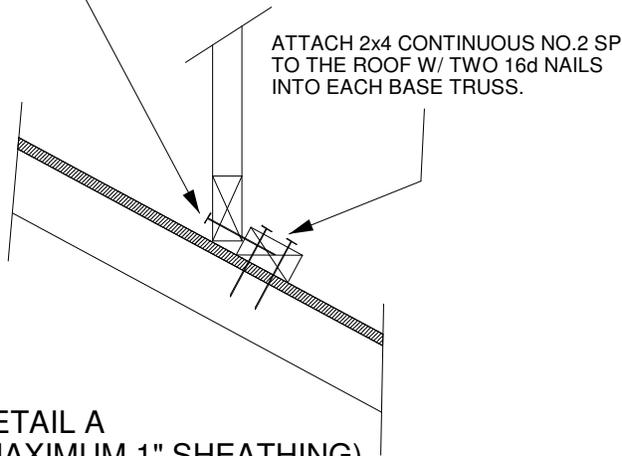

ATTACH 2x4 CONTINUOUS NO.2 SP TO THE ROOF W/ TWO 16d NAILS INTO EACH BASE TRUSS.

DETAIL A (MAXIMUM 1" SHEATHING) N.T.S.

WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 120 MPH  
 WIND DESIGN PER ASCE 7-10, ASCE 7-16 150 MPH  
 MAX MEAN ROOF HEIGHT = 30 FEET  
 ROOF PITCH = MINIMUM 3/12 MAXIMUM 10/12  
 CATEGORY II BUILDING  
 EXPOSURE C OR B  
 WIND DURATION OF LOAD INCREASE : 1.60  
 MAX TOP CHORD TOTAL LOAD = 60 PSF  
 MAX SPACING = 24" O.C. (BASE AND VALLEY)  
 MINIMUM REDUCED DEAD LOAD OF 4.2 PSF ON THE TRUSSES